


# Proportional reducing valves type **RZGO-A\***, **HZGO-A\***, **KZGO-A\***

pilot operated, without integral pressure transducer, subplate or modular mounting, ISO 4401 size 06, 10

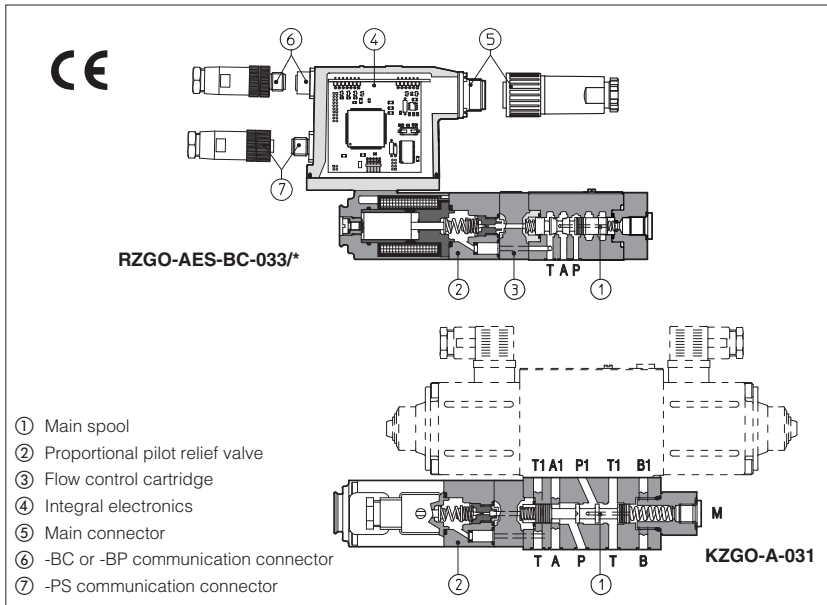

- ① Main spool
- ② Proportional pilot relief valve
- ③ Flow control cartridge
- ④ Integral electronics
- ⑤ Main connector
- ⑥ -BC or -BP communication connector
- ⑦ -PS communication connector

**1 MODEL CODE**

	<b>RZGO</b>	- <b>AES</b> - <b>PS</b> - <b>033/315</b> / *	**	/*				
<p>Proportional pressure reducing valve</p> <p><b>RZGO</b> = subplate (size 06)  <b>HZGO</b> = modular (size 06)  <b>KZGO</b> = modular (size 10)</p> <p><b>A</b> = without integral transducer</p> <p><b>Only for RZGO:</b>  <b>AE</b> = as A plus integral electronics  <b>AES</b> = as A plus integral digital electronics</p> <p>Communication interfaces (only for AES)</p> <p><b>PS</b> = Serial (1)  <b>BC</b> = CANopen  <b>BP</b> = PROFIBUS DP</p> <p>Configuration, see section 3:</p> <p><b>031</b> = regulation on port <b>P1</b>, pressure from P, discharge in T (only for HZGO, KZGO)  <b>033</b> = regulation on port <b>A</b>, pressure from P, discharge in T (only for RZGO)</p>			<p>Synthetic fluids  <b>WG</b> = water-glycol  <b>PE</b> = phosphate ester</p> <p>Series number</p> <p><b>Options for -A execution</b>, see section 5:  <b>6</b> = with 6 V<sub>DC</sub> coil instead of standard 12V<sub>DC</sub> coil  <b>18</b> = with 18 V<sub>DC</sub> coil instead of standard 12V<sub>DC</sub> coil</p> <p><b>Electronics options for -AE execution</b>, see section 7:  <b>I</b> = current reference input (4÷20 mA)  <b>Q</b> = enable signal</p> <p><b>Electronics options for -AES execution</b>, see section 9:  <b>Q</b> = enable signal  <b>Z</b> = adds double power supply, enable and fault signals (12 pin connector)</p>					
			<p>Pressure range</p> <table style="width: 100%;"> <tr> <td><b>50</b> = 50 bar</td> <td><b>100</b> = 100 bar</td> </tr> <tr> <td><b>210</b> = 210 bar</td> <td><b>315</b> = 315 bar</td> </tr> </table>	<b>50</b> = 50 bar	<b>100</b> = 100 bar	<b>210</b> = 210 bar	<b>315</b> = 315 bar	
<b>50</b> = 50 bar	<b>100</b> = 100 bar							
<b>210</b> = 210 bar	<b>315</b> = 315 bar							

(1) Serial interface always present, also for -BC and -BP options

They are proportional pressure reducing valves, 3-way, pilot operated, available in two different executions:  
 - R subplate mounting;  
 - H or K modular mounting.

They operate in association with electronic drivers, see table 2 which supply the proportional valve with proper current signal to align valve regulation to the reference signal supplied to the electronic driver.

They are available in different executions:  
 • -A, without integral pressure transducer.  
 • -AE, -AES, as -A plus analogue (AE) or digital (AES) integral electronics 4.  
 The reduced pressure is controlled by the spool 1 piloted by the proportional pilot relief valve 2. The intermediate compensated flow control cartridge 3 assures constant pilot flow and therefore high pressure stability.

The integral electronics 4 ensures factory presetting, fine functionality plus valve-to-valve interchangeability and simplified wiring and installation.

The electronic main connector 5 is fully interchangeable for -AE and -AES executions. Standard 7 pin connector is used for power supply, analog input reference and monitor signals. 12 pin connector is used for option /Z (AES).

Following communication interfaces 6, 7 are available for the digital -AES execution:

- standard -PS, Serial communication interface for configuration, monitoring and firmware updating through Atos PC software - always present
- optional -BC, CANopen interface
- optional -BP, PROFIBUS DP interface.

The valves with -BC and -BP interfaces can be integrated into a fieldbus communication network and thus digitally operated by the machine control unit.

The coils are fully plastic encapsulated (insulation class H), and the valves have antivibration, antishock and weather-proof features.

Reduced pressure on port A for valves 033 and on port P1 for valves 031.

Mounting surface: ISO 4401 size 06, 10  
 Max flow: 100 l/min  
 Max pressure: 315 bar

**2 ELECTRONIC DRIVERS FOR \*ZGO**

Valve model	-A					-AE	-AES	
Drivers model	E-MI-AC-01F	E-MI-AS-IR	E-BM-AC-01F	E-BM-AS-PS	E-ME-AC-01F	E-RP-AC-01F	E-RI-AE	E-RI-AES
Data sheet	G010	G020	G025	G030	G035	G100	G110	G115

**Note:** for power supply and communication connector see section 15

### 3 HYDRAULIC CHARACTERISTICS (based on mineral oil ISO VG 46 at 50 °C)

Hydraulic symbols		RZGO-A, -AE, -AES, HZGO-A				KZGO-A-031		
Valve model		<b>RZGO-A, -AE, -AES, HZGO-A</b>				<b>KZGO-A</b>		
Max. reduced pressure (Q = 10 l/min)		50	100	210	315	100	210	315
Min. reduced pressure (Q = 10 l/min) [bar]		1 or actual value at T port						
Max. pressure at ports P, T [bar]		port P = 315 bar; port T = 210 bar						
Minimum flow [l/min]		2,5				3		
Maximum flow [l/min]		40				100		
Response time 0 - 100% step signal (depending on installation) [ms]		≤ 50				≤ 80		
Hysteresis [% of the max regulated pressure]						≤ 2		
Linearity [% of the max regulated pressure]						≤ 3		
Repeatability [% of the max regulated pressure]						≤ 2		

Above performance data refer to valves coupled with Atos electronic drivers, see section 2.

### 4 GENERAL NOTES

RZGO, HZGO and KZGO proportional valves are CE marked according to the applicable Directives (e.g. Immunity/Emission EMC Directive and Low Voltage Directive).

Installation, wirings and start-up procedures must be performed according to the general prescriptions shown in table F003 and in the installation notes supplied with relevant components.

The electrical signals of the valve (e.g. monitor signals) must not be directly used to activate safety functions, like to switch-ON/OFF the machine's safety components, as prescribed by the European standards (Safety requirements of fluid technology systems and components-hydraulics, EN-982).

### 5 OPTIONS FOR -A EXECUTION

**5.1 Option /6** 6 V<sub>DC</sub> coil instead of standard 12 V<sub>DC</sub>, to be used in case of power supply 12 V<sub>DC</sub>

**5.2 Option /18** 18 V<sub>DC</sub> coil instead of standard 12 V<sub>DC</sub>, to be used with electronic drivers not supplied by Atos

### 6 CONNECTIONS FOR -A EXECUTION

SOLENOID POWER SUPPLY CONNECTOR		
PIN	Signal description	
1	SUPPLY	
2	SUPPLY	
3	GND	

### 7 ANALOG INTEGRAL DRIVERS -AE - OPTIONS

Standard driver execution provides on the 7 pin main connector:

**Power supply** - 24V<sub>DC</sub> must be appropriately stabilized or rectified and filtered; a 2,5 A safety fuse is required in series to the driver power supply. Apply at least a 10000 µF/40 V capacitance to single phase rectifiers or a 4700 µF/40 V capacitance to three phase rectifiers

**Reference input signal** - analog differential input with 0÷+10 V<sub>DC</sub> nominal range (pin D,E), proportional to desired coil current

**Monitor output signal** - analog output signal proportional to the actual valve's coil current (1V monitor = 1A coil current)

Following options are available to adapt standard execution to special application requirements:

#### 7.1 Option /I


It provides the 4÷20 mA current reference signal instead of the standard 0÷+10 V<sub>DC</sub>. Monitor output signal is still the standard 0÷+10 V<sub>DC</sub>. It is normally used in case of long distance between the machine control unit and the valve or where the reference signal can be affected by electrical noise; the valve functioning is disabled in case of reference signal cable breakage.

#### 7.2 Option /Q

It provides the possibility to enable or disable the valve functioning without cutting the power supply (the valve functioning is disabled but the driver current output stage is still active). To enable the driver supply a 24V<sub>DC</sub> on the enable input signal.

#### 7.3 Possible combined option: /IQ

## 8 DIGITAL INTEGRAL DRIVERS -AE - MAIN FUNCTIONS AND ELECTRONIC CONNECTIONS

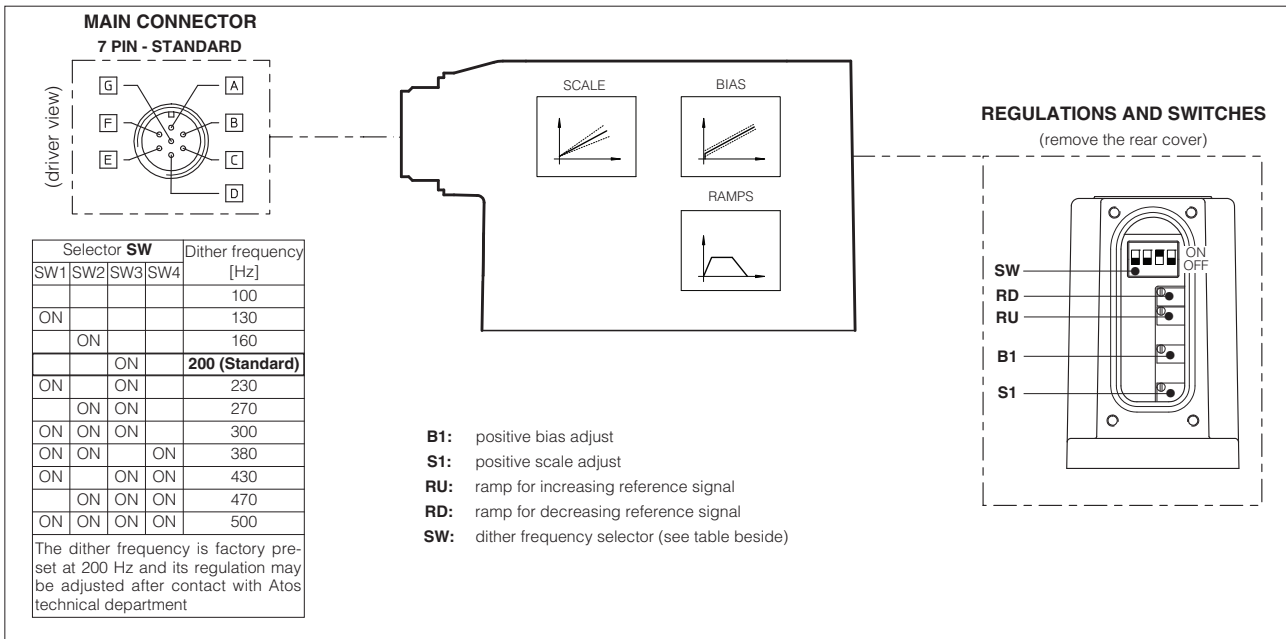

### 8.1 ELECTRONIC CONNECTIONS - 7 PIN MAIN CONNECTORS

PIN	SIGNAL	TECHNICAL SPECIFICATIONS	NOTES
A	V+	Power supply 24 Vdc for solenoid power stage and driver logic	Input - power supply
B	V0	Power supply 0 Vdc for solenoid power stage and driver logic	Gnd - power supply
C (1)	AGND	Ground - signal zero for MONITOR signal	Gnd - analog signal
	ENABLE	Enable (24 Vdc) or disable (0 Vdc) the driver (for /Q option)	Input - on/off signal
D	INPUT+	Reference analog differential input: 0÷+10 Vdc maximum range (4 ÷ 20 mA for /I option)	Input - analog signal
E	INPUT -	Normal working range 0÷+10 Vdc (4 ÷ 20 mA for /I option)	
F	MONITOR	Monitor analog output: 0÷+5 Vdc maximum range; 1 V = 1 A	Output - analog signal
G	EARTH	Internally connected to the driver housing	

**Note:** (1) with /Q option ENABLE signal replaces AGND on pin C; MONITOR signal is referred to pin B.

A minimum time of 60ms to 160ms have to be considered between the driver energizing with the 24 Vdc power supply and when the valve is ready to operate. During this time the current to the valve coils is switched to zero

## 9 DIGITAL INTEGRAL DRIVERS -AES - OPTIONS

Standard driver execution provides on the 7 pin main connector:

**Power supply** - 24Vdc must be appropriately stabilized or rectified and filtered; a 2,5 A safety fuse is required in series to each driver power supply. Apply at least a 10000 µF/40 V capacitance to single phase rectifiers or a 4700 µF/40 V capacitance to three phase rectifiers.

**Reference input signal** - analog differential input with 0÷+10 Vdc nominal range (pin D,E), proportional to desired coil current (4÷20 mA with cable break detection, ± 10 mA, ± 20 mA or 0÷20 mA software selectable)

**Monitor output signal** - analog output signal proportional to the actual valve's coil current (1V monitor = 1A coil current)

Following options are available to adapt standard execution to special application requirements:

### 9.1 Option /Q

To enable the driver, supply 24Vdc on pin C referred to pin B: when the enable signal is set to zero the valve status is software selectable, by factory default the valve functioning is disabled (zero current to the solenoid) but the driver current output stage is still active. For the complete list of selectable status, see tab. G115.

### 9.2 Option /Z

It provides on a 12 pin main connector the following additional features:

#### Logic power supply

Separated power supply for the solenoid (pin 1, 2) and for the digital electronic circuits (pin 9, 10).

Cutting solenoid power supply allows to interrupt the valve functioning but keeping energized the digital electronics thus avoiding fault conditions of the machine fieldbus controller. This condition allows to realize safety systems in compliance with European Norms EN13849-1 (ex EN954-1).


#### Enable Input Signal

To enable the driver, supply 24Vdc on pin 3 referred to pin 2: when the enable signal is set to zero the valve status is software selectable, by factory default the valve functioning is disabled (zero current to the solenoid) but the driver current output stage is still active. For the complete list of selectable status, see tab. G115.

#### Fault Output Signal

Fault output signal indicates fault conditions of the driver (solenoid short circuits/not connected, reference signal cable broken for 4÷20mA input, etc.). Fault presence corresponds to 0 Vdc, normal working corresponds to 24Vdc (pin 11 referred to pin 2): Fault status is not affected by the Enable input signal.

## 10 DIGITAL INTEGRAL DRIVERS -AES - MAIN FUNCTIONS AND ELECTRONIC CONNECTIONS

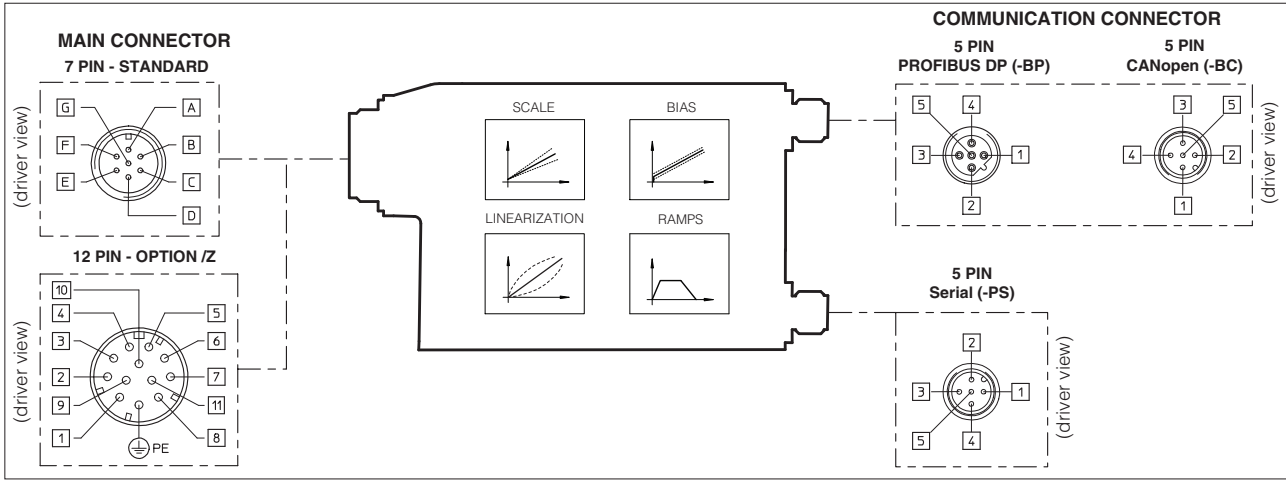

### 10.1 ELECTRONIC CONNECTIONS - 7 & 12 PIN MAIN CONNECTORS

Standard 7pin	/Z option 12pin	SIGNAL	TECHNICAL SPECIFICATIONS	NOTES
A	1	V+	Power supply 24 Vdc for solenoid power stage (and for driver logic on 7 pin connection)	Input - power supply
B	2	V0	Power supply 0 Vdc for solenoid power stage (and for driver logic on 7 pin connection)	Gnd - power supply
D	4	INPUT+	Reference analog input: $\pm 10$ Vdc / $\pm 20$ mA maximum range software selectable Default setting 0+ +10 Vdc differential input /Z option: common mode INPUT+ referred to AGND	Input - analog signal
E	-	INPUT -		
C	3	ENABLE	Enable (24 Vdc) or disable (0 Vdc) the driver	Input - on/off signal
	5	AGND	Ground - signal zero for MONITOR signal signal zero for INPUT+ signal (only for /Z option)	Gnd - analog signal
F	6	MONITOR	Monitor analog output: 0+ +5 Vdc maximum range; 1 V = 1 A	Output - analog signal
-	7	NC	do not connect	
-	8	NC	do not connect	
-	9	VL+	Power supply 24 Vdc for driver logic	Input - power supply
-	10	VL0	Power supply 0 Vdc for driver logic	Gnd - power supply
-	11	FAULT	Fault (0 Vdc) or normal working (24 Vdc)	Output - on/off signal
G	PE	EARTH	Internally connected to the driver housing	

**Note:** A minimum time of 270 to 340 ms have be considered between the driver energizing with the 24Vdc power supply and when the valve is ready to operate. During this time the current to the valve coils is switched to zero.

### 10.2 ELECTRONIC CONNECTIONS - 5 PIN COMMUNICATION CONNECTORS

PIN	-PS Serial		-BC CANopen		-BP PROFIBUS DP	
	SIGNAL	TECHNICAL SPECIFICATION	SIGNAL	TECHNICAL SPECIFICATION	SIGNAL	TECHNICAL SPECIFICATION
1	NC	do not connect	CAN_SHLD	Shield	+5V	for termination
2	NC	do not connect	NC	do not connect	LINE-A	Bus line (high)
3	RS_GND	Signal zero data line	CAN_GND	Signal zero data line	DGND	data line and termination Signal zero
4	RS_RX	Valves receiving data line	CAN_H	Bus line (high)	LINE-B	Bus line (low)
5	RS_TX	Valves transmitting data line	CAN_L	Bus line (low)	SHIELD	

## 11 SOFTWARE TOOLS

The driver configuration and parameters can be easily set with the Atos E-SW programming software, available in three different versions according to the driver's communication execution: E-SW-PS (Serial), E-SW-BC (CANopen) and E-SW-BP (PROFIBUS DP). Programming software E-SW-BC and E-SW-BP, for BC and BP drivers, can be also used to modify the valve's parameterization through the serial communication interface, without disconnecting the valve from the machine's bus line.

For a more detailed description of software interface, PC requirements, adapters, cables and terminators, please refer to technical table G500.

**Programming software, must be ordered separately:**

**E-SW-\*** (mandatory - first supply) = Dvd including E-SW-\* software installer and operator manuals; it allows the registration to Atos digital service

**E-SW-\*-N** (optional - next supplies) = as above but not allowing the registration to Atos digital service

On first supply of the E-SW-\* software, it is required to apply for the registration in the Atos download area: [www.download.atos.com](http://www.download.atos.com).

Once the registration is completed, the password will be sent by email.

The software remains active for 10 days from the installation date and then it stops until the user inputs his password.

With the password you can also download, in your personal area, the latest releases of the Atos software, manuals, drivers and configuration files.

## 12 MAIN CHARACTERISTICS OF PROPORTIONAL REDUCING VALVES

Assembly position	Any position
Subplate surface finishing	Roughness index, $\sqrt{0.4}$ flatness ratio 0,01/100 (ISO 1101)
Ambient temperature	-20°C ÷ +70°C for -A execution; -20°C ÷ +60°C for -AE and -AES executions
Fluid	Hydraulic oil as per DIN 51524 ... 535 for other fluids see section 11
Recommended viscosity	15 ÷ 100 mm <sup>2</sup> /s at 40°C (ISO VG 15÷100)
Fluid contamination class	ISO 18/15 achieved with in line filters of 10 µm and $\beta_{10} \geq 75$ (recommended)
Fluid temperature	-20°C +60°C (standard and /WG seals) -20°C +80°C (/PE seals)
Coil resistance R at 20°C	3 ÷ 3.3 Ω for standard 12 Vdc coil; 2 ÷ 2.2 Ω for 6 Vdc coil; 13 ÷ 13.4 Ω for 18 Vdc coil
Max solenoid current	2.4 A (1.8 A for version /32) for standard 12 Vdc coil; 3 A (2.25 A for version /32) for 6 Vdc coil; 1 A (0.8 A for version /32) for 18 Vdc coil
Max power	40 Watt
Protection degree (CEI EN-60529)	IP65 for -A execution; IP67 for -AE and AES executions
Duty factor	Continuous rating (ED=100%)

**13 DIAGRAMS** (based on mineral oil ISO VG 46 at 50 °C)



**13.1 Regulation diagrams**

with flow rate  $Q = 10 \text{ l/min}$

- 1** = RZGO-A; RZGO-AE; RZGO-AES, HZGO-A
- 2** = KZGO-A

**Note:**


The presence of counter pressure at port T can affect the effective pressure regulation.

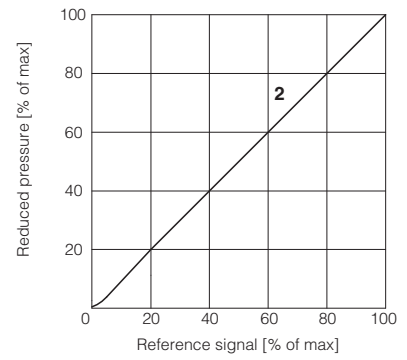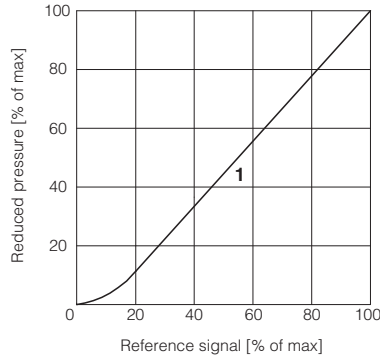

**13.2 Pressure/flow diagrams**

with reference pressure set with  $Q = 10 \text{ l/min}$

- 3** = RZGO-A; RZGO-AE; RZGO-AES, KZGO-A

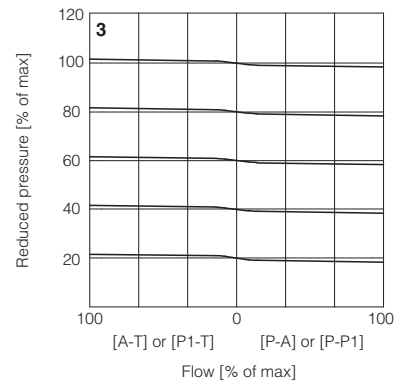



**13.3 Pressure drop/flow diagram**

RZGO-A\*, HZGO-A

- 4** = A-T or P1-T
- 5** = P-P1 or P-A


KZGO-A

- 6** = P1-T
- 7** = P-P1

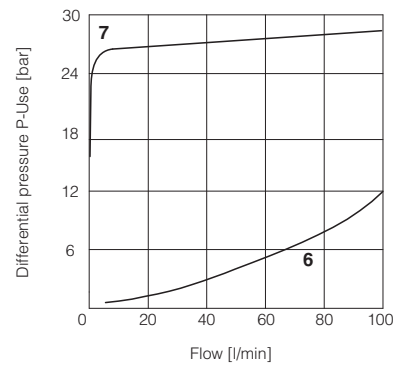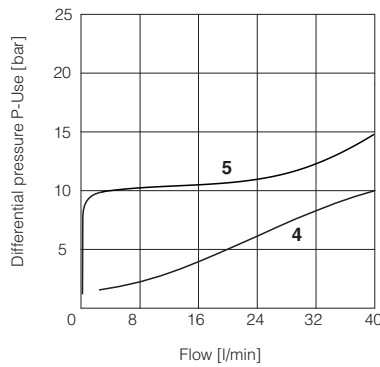


**14** INSTALLATION DIMENSIONS [mm]

**ISO 4401: 2000**  
**Mounting surface: 4401-03-02-0-05 (see tab. P005)**  
 Fastening bolts:  
 4 socket head screws M5X50 bolts class 12.9  
 Tightening torque = 8 Nm  
 Seals: 4 OR 108  
 Ports P, A, B, T:  $\varnothing$  5 mm

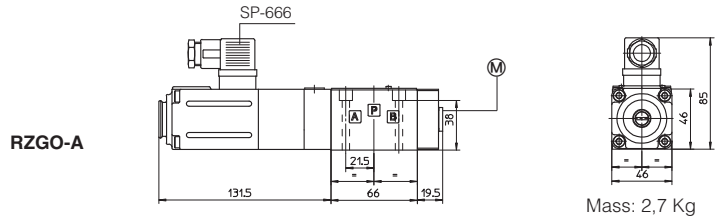

Mass: 2,7 Kg


**RZGO-AE**  
**RZGO-AES\* (dotted line)**

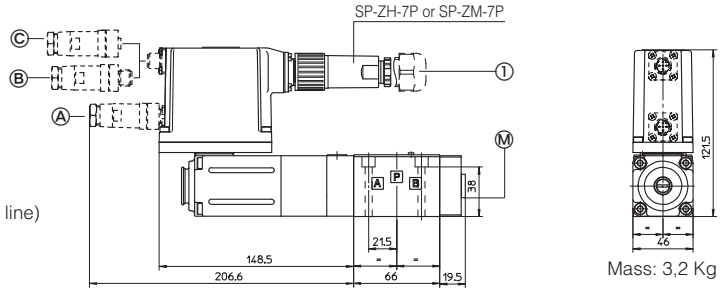

Mass: 3,2 Kg


- ① Dotted line = 12 pin connector SP-ZH-12P for option /Z
- Ⓐ -PS communication interface, SP-ZH-5P connector
- Ⓑ -BP communication interface, SP-ZH-5P/BP connector
- Ⓒ -BC communication interface, SP-ZH-5P connector
- Ⓜ Pressure gauge connection port = G1/4"

**ISO 4401: 2000**  
**Mounting surface: 4401-03-02-0-05 (see tab. P005)**  
 Fastening bolts: M5 class 12.9  
 Tightening torque = 8 Nm  
 Seals: 4 OR 108  
 Ports P, A, B, T:  $\varnothing$  = 5 mm

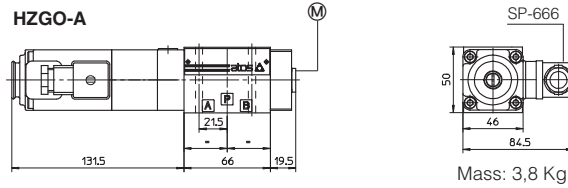

Mass: 3,8 Kg

**ISO 4401: 2000**  
**Mounting surface: 4401-05-04-0-05 (see tab. P005)**  
 Fastening bolts: M6 class 12.9  
 Tightening torque = 15 Nm  
 Seals: 5 OR 2050.1 OR 108  
 Ports P,A,B,T:  $\varnothing$  = 11.5 mm (max)

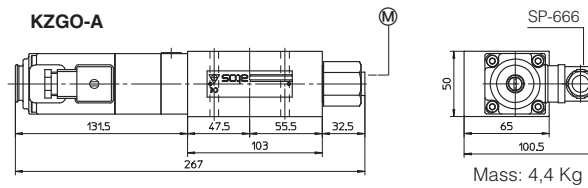

Mass: 4,4 Kg

**15** MODEL CODES OF POWER SUPPLY AND COMMUNICATION CONNECTORS (to be ordered separately)

VALVE VERSION	-A	-AE, -AES		-AES/Z	-Serial (-PS) or CANopen (-BC)	PROFIBUS DP (-BP)
CONNECTOR CODE	SP-666	SP-ZH-7P	SP-ZM-7P	SP-ZH-12P	SP-ZH-5P	SP-ZH-5P/BP
PROTECTION DEGREE	IP65	IP67	IP67	IP67	IP67	IP67
DATA SHEET	K500	G110, G115, K500			G115, K500	

connectors supplied with the valve